


Lac Gauvreau – Coliform Test Results: Count/100ml – Summer 2007

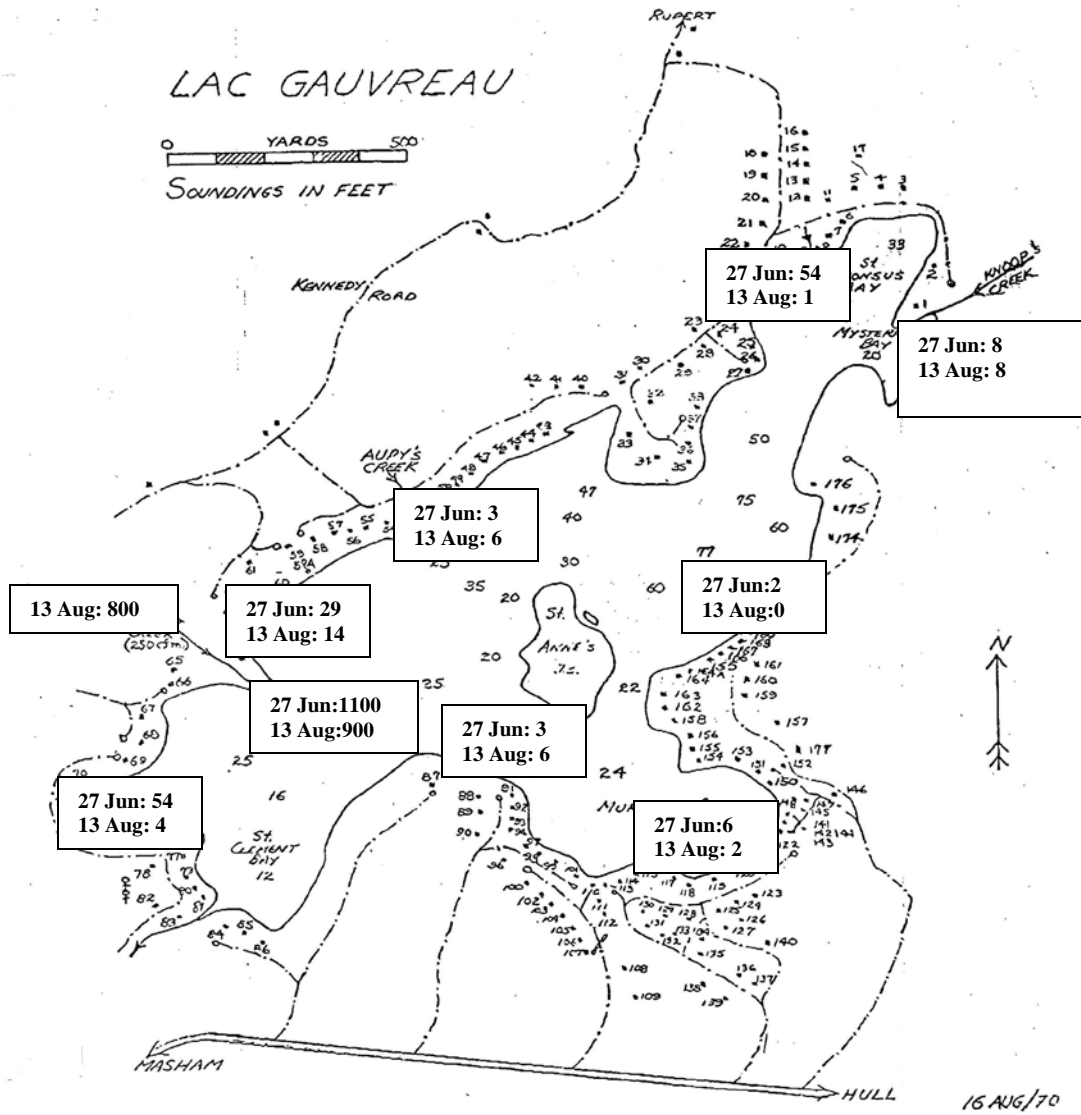

Province of Québec Standards for Swimming (Units: UFC/100ml)

- 0 –20: Excellent
- 21 –100: Good
- 101 – 200: Acceptable
- 201 - +: Not recommended